



CHANGES FOR REPLACEMENT FROM RELAY RA221 TO RA25A





Model Discontinued



New Model

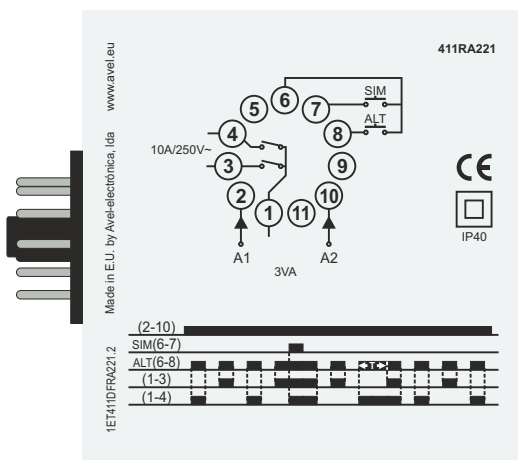

Operating diagram
RA221

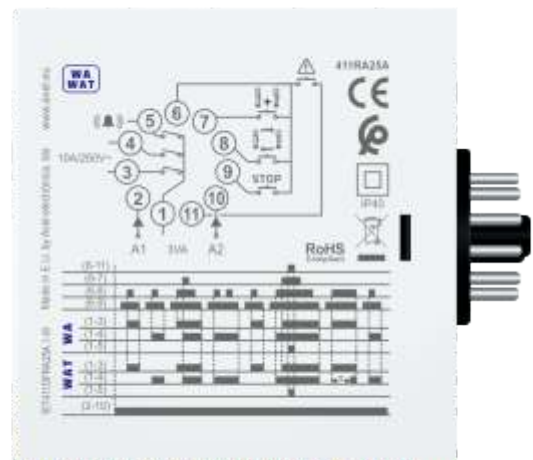

Operating diagram
RA25A

Add a shunt connection between pins 8 and 9 of the RA25A relay;
Keep the remaining connections.

NOTE 1: The RA25A relay switch should be placed in the position corresponding to the WAT application;

NOTE 2: 10-minute delay for automatic activation of simultaneity.